




01 Planta eléctrica contactos
IE-02 Esc: 1:1

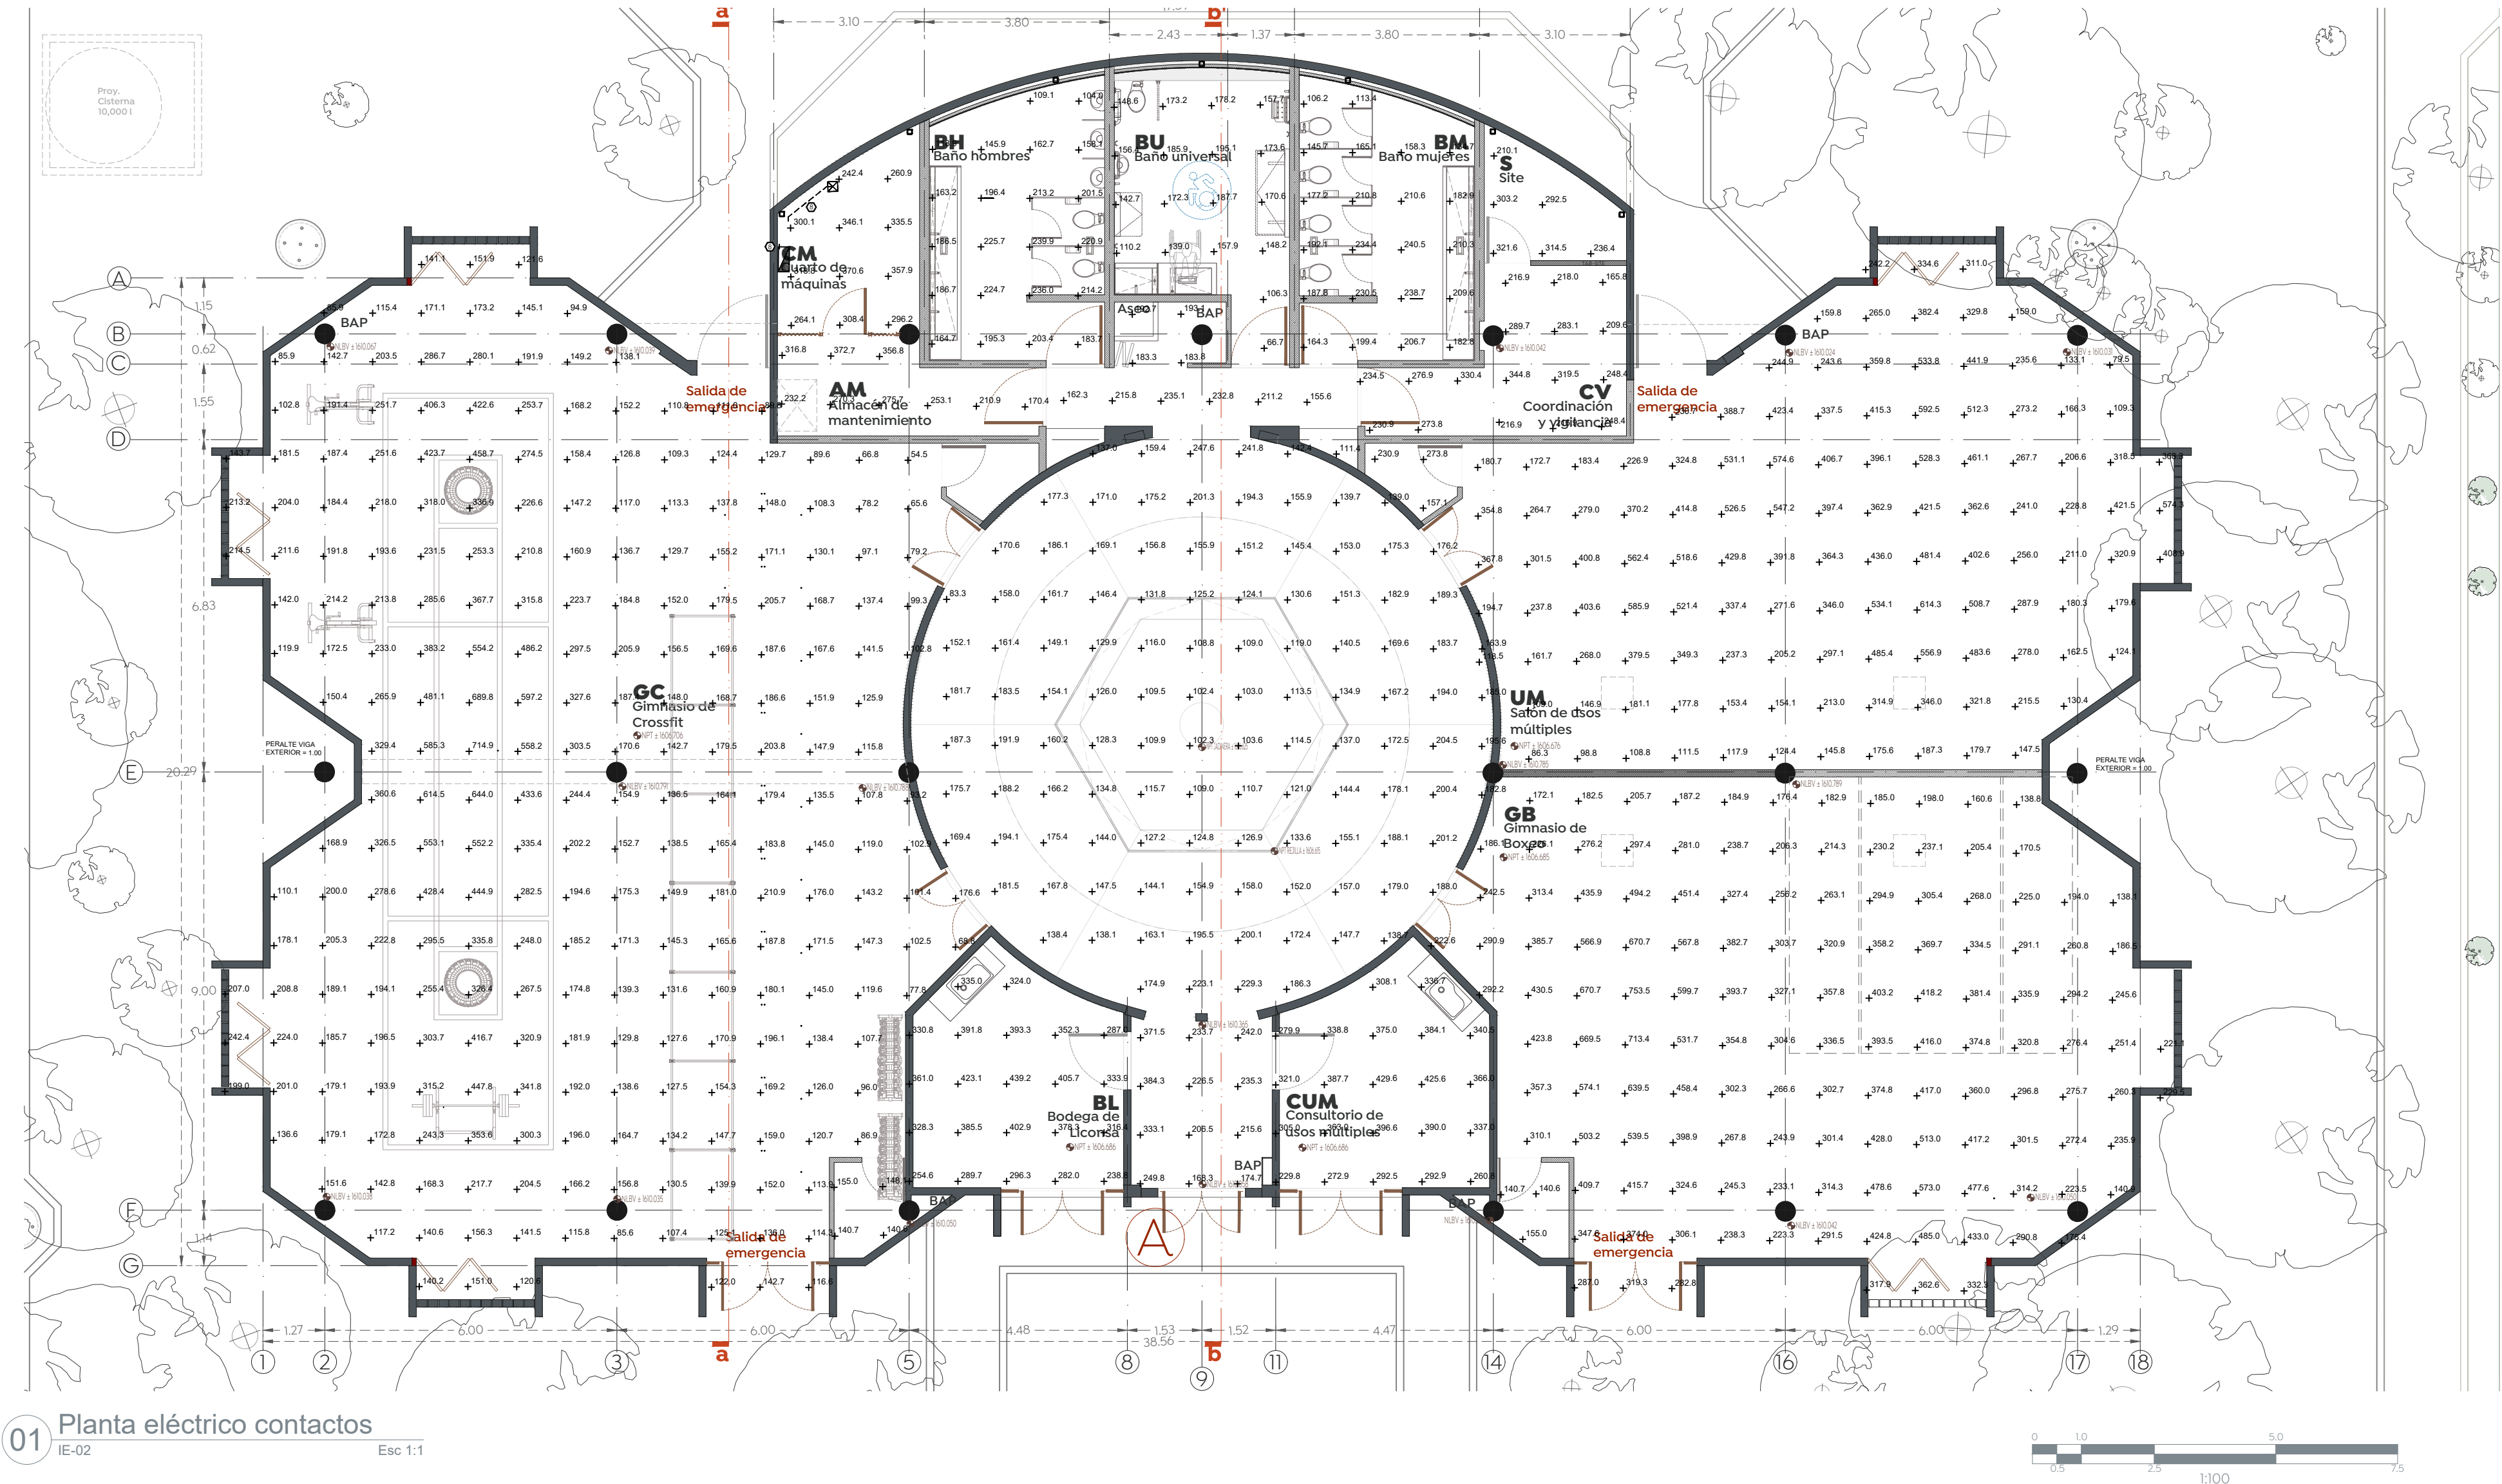


Statistics						
Description	Symbol	Avg	Max	Min	Max/Min	Avg/Min
Almacen de mto	+	268.2 lux	397.0 lux	156.4 lux	2.5:1	1.7:1
Aseo	+	198.9 lux	209.1 lux	191.6 lux	1.1:1	1.0:1
Baño hombres	+	184.2 lux	239.8 lux	103.9 lux	2.3:1	1.8:1
Baño mujeres	+	186.5 lux	240.5 lux	106.2 lux	2.3:1	1.8:1
Baño Universal	+	120.9 lux	135.0 lux	94.0 lux	1.4:1	1.3:1
Bodega liconsa	+	348.8 lux	430.1 lux	260.2 lux	1.7:1	1.3:1
Box	+	288.7 lux	737.3 lux	84.5 lux	8.7:1	3.4:1
Consultorio	+	339.9 lux	417.9 lux	254.1 lux	1.6:1	1.3:1
Coordinación y vigilancia	+	262.0 lux	345.5 lux	166.0 lux	2.1:1	1.6:1
Crossfit	+	193.2 lux	712.1 lux	68.8 lux	10.4:1	2.8:1
Cuarto de máquinas	+	324.1 lux	395.3 lux	248.4 lux	1.6:1	1.3:1
Pasillo	+	202.2 lux	218.4 lux	168.9 lux	1.3:1	1.2:1
Site	+	279.7 lux	321.6 lux	210.1 lux	1.5:1	1.3:1
Uso multiples	+	267.6 lux	568.5 lux	56.9 lux	10.0:1	4.7:1
Vestidor 1	+	176.2 lux	208.1 lux	152.5 lux	1.4:1	1.2:1
Vestidor 2	+	145.5 lux	153.9 lux	140.6 lux	1.1:1	1.0:1
Vestidor 3	+	222.9 lux	275.3 lux	161.3 lux	1.7:1	1.4:1
Vestidor 4	+	135.7 lux	135.7 lux	135.7 lux	1.0:1	1.0:1
Acceso	+	161.0 lux	247.1 lux	101.2 lux	2.4:1	1.6:1

02 Statistics
IE-07 S/E

Schedule									
Symbol	Label	QTY	Manufacturer	Catalog	Description	Number Lamps	Lamp Output	LLF	Input Power
○	A	40	MAGG		LUNA 9 SSD IP 65 4000K	1	740	1	9
⊗	B	33	MAGG		LUNA 25 FLAT 4000K SOBREPONER	1	2300	1	25
⊗	C	10	MAGG		LUNA 3 4000K	1	200	1	3
⊗	D	15	MAGG		GAMMA TOT 1200 100-305V 40K GR (ESPECIAL)	1	3600	1	30
⊗	E	15	MAGG		BL FLAT 1200 4000K OPAL	1	530	1	8

03 Schedule
IE-07 S/E

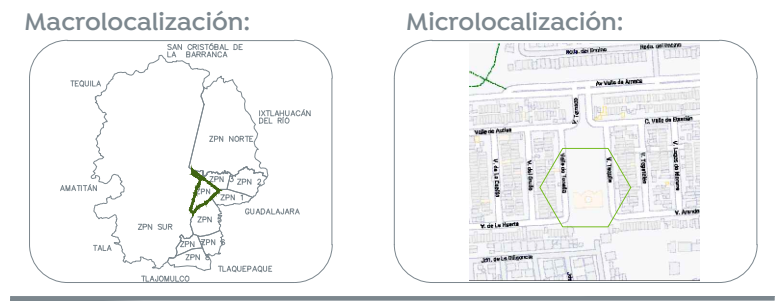

Especificaciones: