




Punto	Tramo	Pot. (W)	Long. (m)	Amp.	Voltaje final	Cond. mm ²	Cond. AWG	Regulación %	Σ Regulación %	Iccsim Cond.	Interrupor
1	A5	150	13.0000	1.3123	126.95	21.200	4	0.04	0.04	9,907.76	
2	A5	115	12.0000	1.0065	126.91	21.200	4	0.029	0.07		
3	A5	100	10.0000	0.8755	126.86	21.200	4	0.040	0.11		
4	A6	5	80.0000	0.0438	126.85	21.200	4	0.008	0.12		

SIMBOLOS DIAGRAMA UNIFILAR

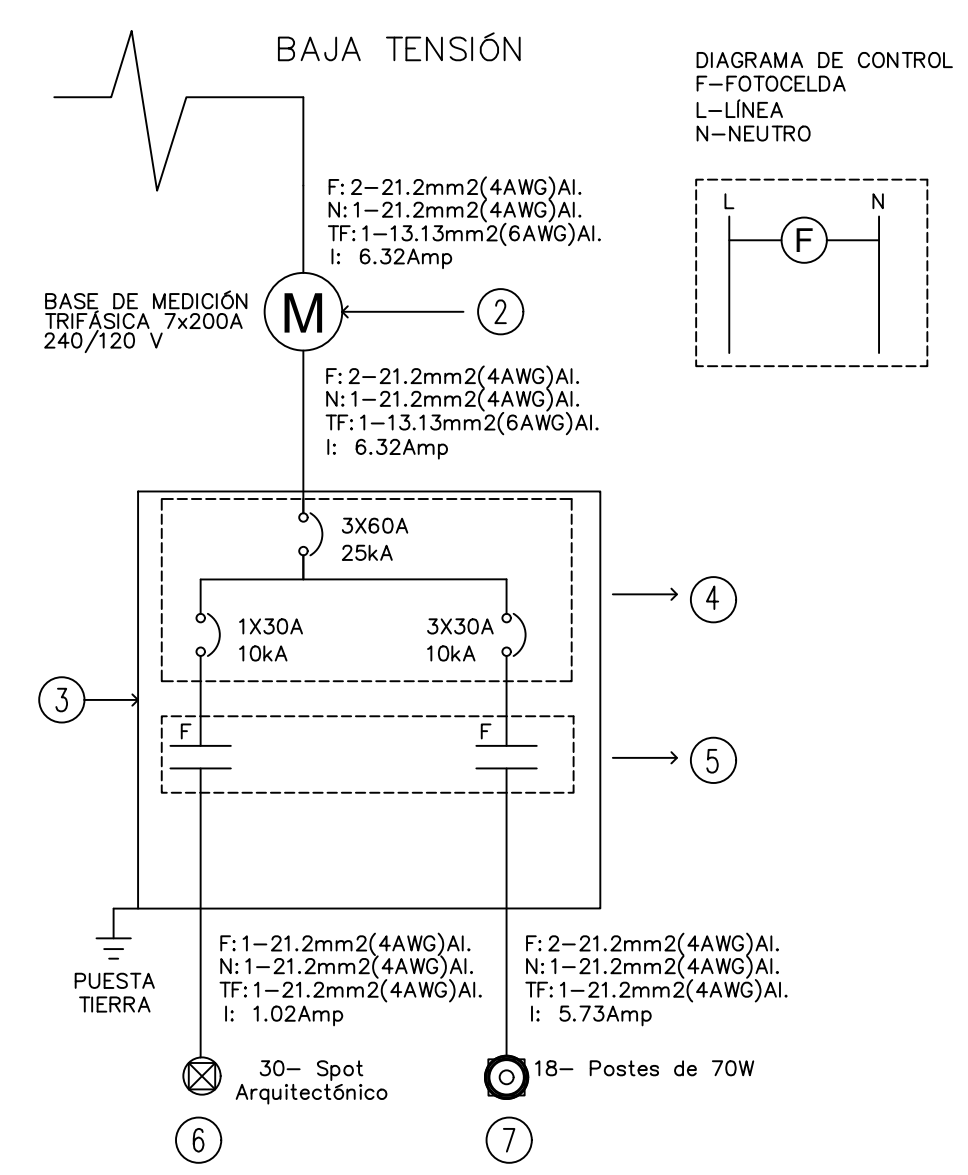

No.	FASES Y REGRESOS mm ² (AWG)	NEUTRO mm ² (AWG)	PUESTA TIERRA mm ² (AWG) D=DESNUDO A=AISLADO	TUBERIA (mm)Ø	MATERIALES CANALIZ. CONDUC.	
●	2-21.2(4)	---	1-13.3(6)A	27(1)	PAD	ALUMINIO
●	1-21.2(4)	1-21.2(4)	1-13.3(6)A	27(1)	PAD	ALUMINIO
●	1-21.2(4)	1-21.2(4)	1-13.3(6)A	27(1)	IMC	ALUMINIO